

DO NOT SCALE

IF IN DOUBT, ASK!

REVISIONS			
REV.	DESCRIPTION	DATE	DRAWN
1	FIRST ISSUE	05/12/2014	CC

- Notes:
- The sizing and detail of the load-bearing supports must be specified and signed off by the Structural Engineer for the project.
 - Unit supplied pre-assembled with 4 no. mounting brackets.
 - If mixed air delivery grille is <2.7m from above finish floor level, finger guard grilles must be used.
 - Dimension A - for installation purposes, ensure sufficient gap between object (i.e. side wall) and A500.

TOLERANCES EXCEPT WHERE OTHERWISE STATED

X	±	0.5MM
X.XX	±	0.05MM
ANGLES	±	0.5°

SURFACE TEXTURE TO BE 1.6 UMRA OR BETTER

DE-BURR ALL SHARP EDGES AND HOLES. ITEM MUST BE FREE FROM SCRATCHES, DENTS AND OTHER BLEMISHES.

DIMENSIONS IN MILLIMETRES



15 STURTON STREET, CAMBRIDGE, CB1 2SN
 T: 01223 450060 F: 01223 450061
 WWW.BREATHINGBUILDINGS.COM

TITLE:
A500 INSTALLATION GA


DRAWING NO:
1418_9002_01

MATERIAL:

FINISH:

REV	DRAWN	DATE	CHK'D	DATE
1	CC	12/05/2014		

SCALE 1:50 A3 SHEET 1 OF 2

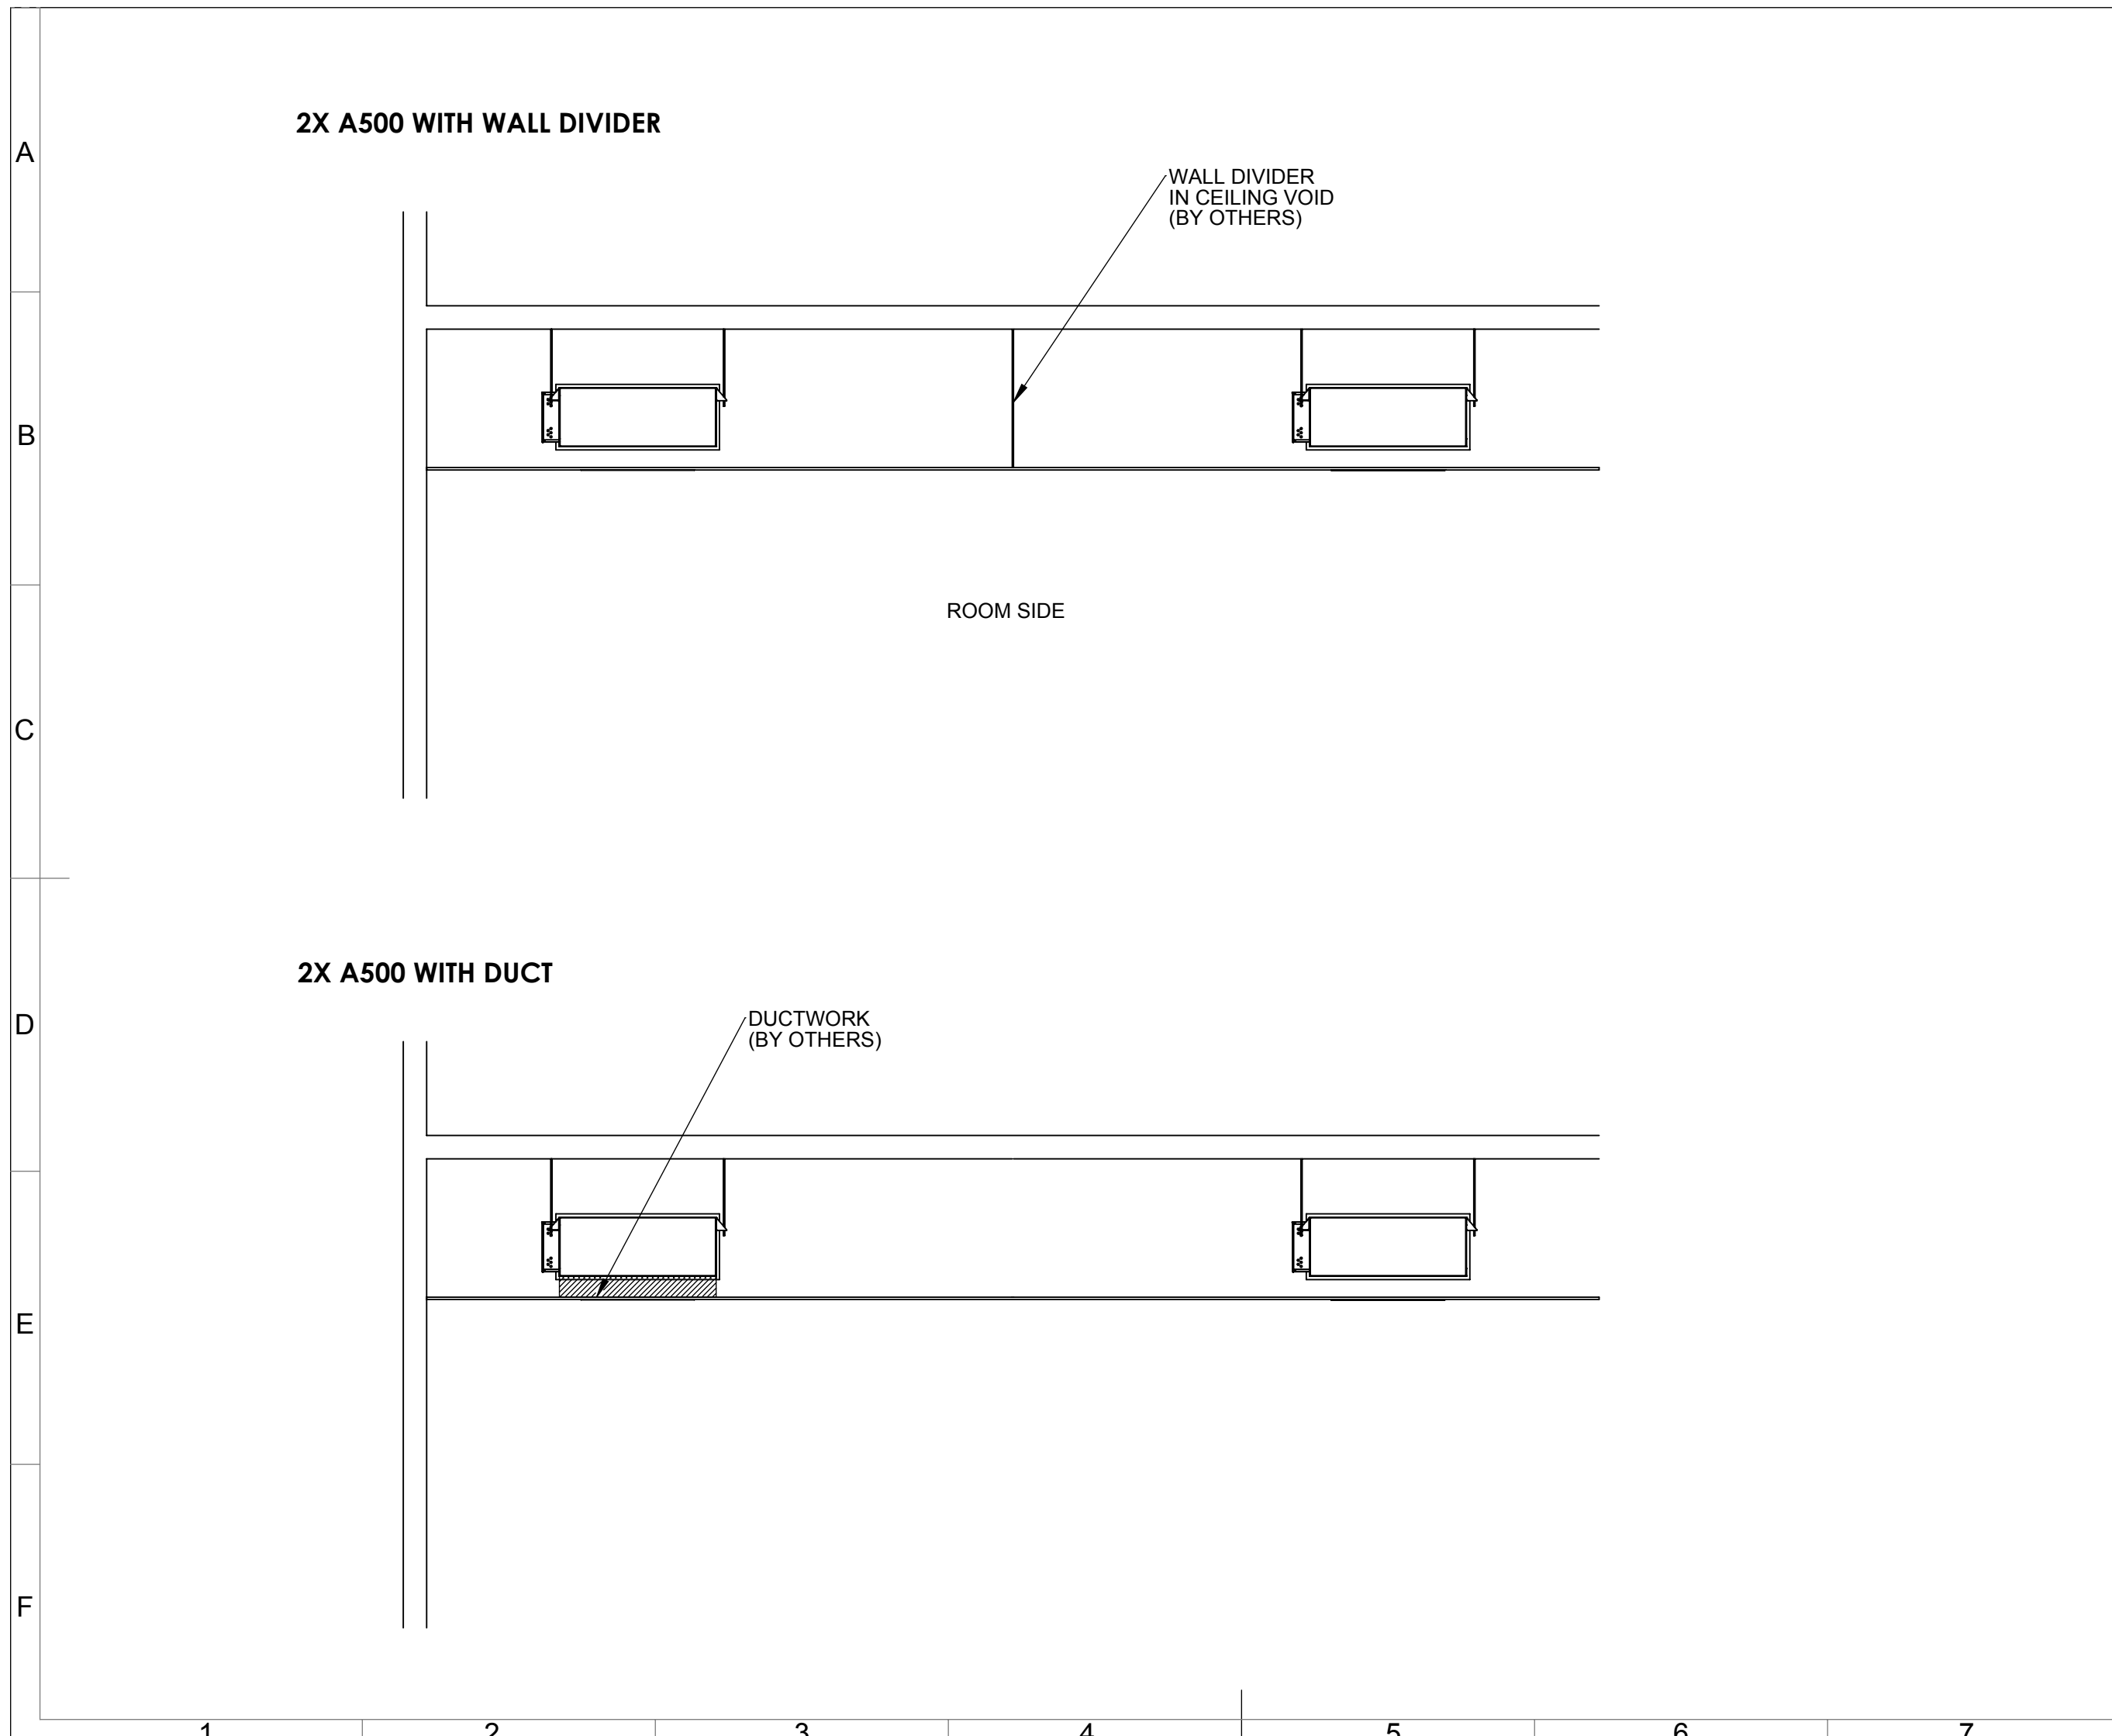

DO NOT SCALE

IF IN DOUBT, ASK!

REVISIONS

ZONE	REV.	DESCRIPTION	DATE	APPROVED
-	-	See Sheet1	-	-

TOLERANCES EXCEPT WHERE OTHERWISE STATED

X	±	0.5MM
X.XX	±	0.05MM
ANGLES	±	0.5°

SURFACE TEXTURE TO BE 1.6 UMRA OR BETTER

DE-BURR ALL SHARP EDGES AND HOLES
ITEM MUST BE FREE FROM SCRATCHES, DENTS AND OTHER BLEMISHES.

DIMENSIONS IN MILLIMETRES



15 STURTON STREET, CAMBRIDGE, CB1 2SN
T: 01223 450060 F: 01223 450061
WWW.BREATHINGBUILDINGS.COM

TITLE:
A500 INSTALLATION GA

DRAWING NO:
1418_9002_01

MATERIAL:

FINISH:

REV	DRAWN	DATE	CHK'D	DATE
1	CC	12/05/2014		

SCALE 1:50 A3 SHEET 2 OF 2